


SECTIONAL PLAN

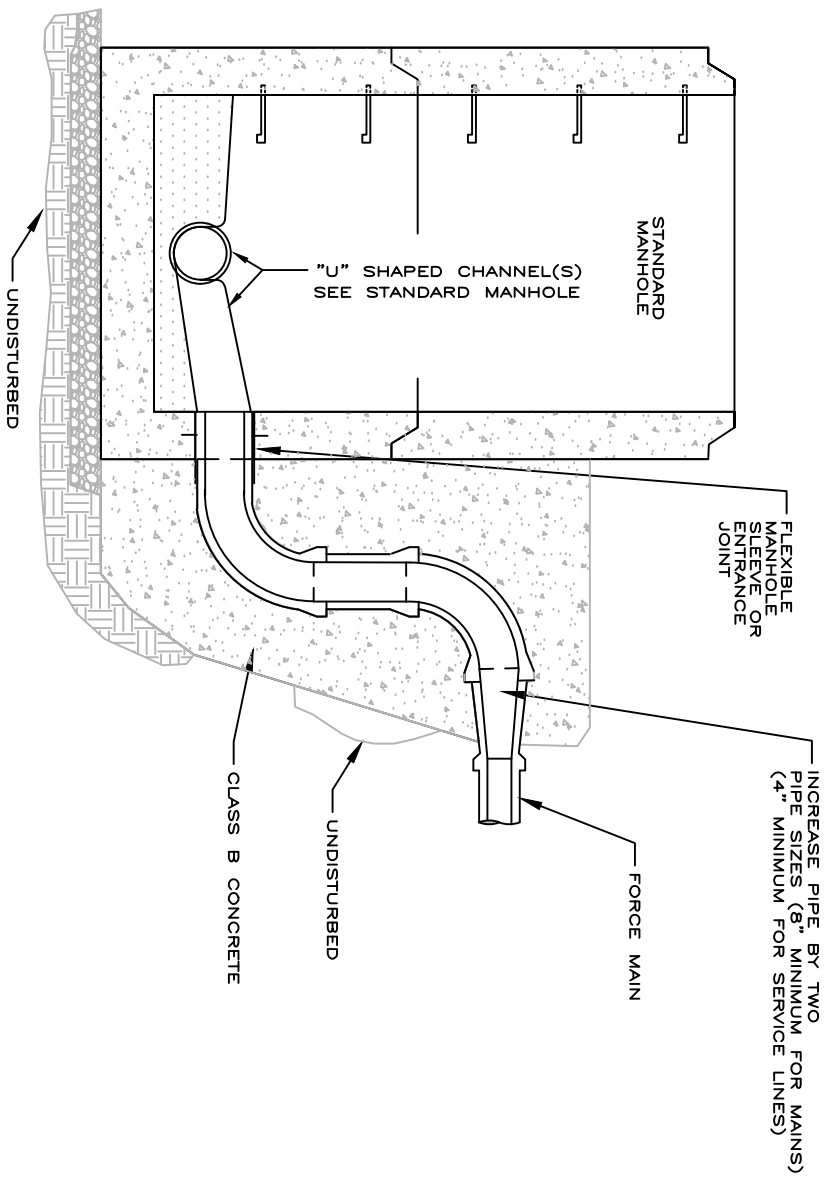

SECTION E-E

MINIMUM FORCE MAIN SIZE FOR PUBLIC SEWER SHALL BE 4" DIA.

NOT TO SCALE

TYPE 2 FORCE MAIN CONNECTION

5.12

DATE	BY	DESCRIPTION
9/27/06	MEN	ADDED NOTES, MIN SIZE
5/28/22	BGM	CHANGE FONT, TITLE BLOCK

